

1 Scope

The Standard Open type transducers provide high sensitivity, wider bandwidth, and excellent durability in wide temperature and humidity ranges and high stability in electrical and mechanical characteristics. Due to its free vibration character the open type transducers are very suitable for continual wave driving, such as Doppler motion detector.

2 Part Number

400ST16M / 400SR16M Open Type Air Ultrasonic Ceramic Transducer

3 Dimension

As per Figure 1

4 Specification

(rated at temperature $25\pm 3^{\circ}\text{C}$, 45 to 60% RH, unless otherwise noted)

Model Number: 400ST16M			
	Items	Specification	Remarks
4-1	Center Frequency	$40.0\pm 1.0\text{KHz}$	
4-2	Sound Pressure Level	120dB (min)	At 40KHz; 0dB re 0.0002 μbar per 10Vrms at 30cm 10Vrms Sine Wave input Detail see attached Figure 2
4-3	Bandwidth	2.0KHz (min)	-6dB
4-4	Capacitance	$2400\pm 20\%\text{pF}$	Measured at 1KHz
4-5	Beam Angle	55° (TYP.)	-6dB
4-6	Operation Temperature	-30°C to $+70^{\circ}\text{C}$	
4-7	Storage Temperature	-40°C to $+80^{\circ}\text{C}$	

Model Number: 400SR16M			
	Items	Specification	Remarks
4-8	Center Frequency	$40.0\pm 1.0\text{KHz}$	
4-9	Sensitivity	-61dB (min)	At 40KHz; 0dB=1Volt/ μbar Detail see attached Figure 3
4-10	Bandwidth	2.5KHz (min)	-6dB
4-11	Capacitance	$2400\pm 20\%\text{pF}$	Measured at 1KHz
4-12	Operation Temperature	-30°C to $+70^{\circ}\text{C}$	
4-13	Storage Temperature	-40°C to $+80^{\circ}\text{C}$	

5 Environmental Characteristics

- 5-1 Overall echo sensitivity shall not change by more than $\pm 3\text{dB}$ in the temperature range of -30°C to 70°C , at a relative humidity of $\pm 50\%$
- 5-2 Overall echo sensitivity shall not change by more than $\pm 3\text{dB}$ in the humidity range of 10% to 90% at the temperature of 25°C
- 5-3 Overall echo sensitivity shall be within $\pm 3\text{dB}$ of the specified values after the device is subjected to any or all of the belows
 - 5-3-1 Operation at 90% relative humidity and 40°C for 100 hours, followed by a normalization period of 24 hours at 30% and 25°C
 - 5-3-2 Storage at -40°C to $+80^{\circ}\text{C}$ for 24 hours followed by a normalization period of an hour at 25°C
 - 5-3-3 Vibration at 10 to 55Hz, 1.5mm amplitude. 1 minute sweep. X, Y, Z, 3 each axis for 3 hours.
 - 5-3-4 Shock: After impact of 50G is applied following. X, Y, Z, 3 axis /3 cycle / each direction.
 - 5-3-5 Drop: After free drop from 1 meter height onto concrete floor, 3 times

6 Mechanical Characteristics

Lead strength

To pull longitudinally 1.0 kgf min.

To push longitudinally 1.0 kgf min.

7 Warranty

- 7-1 Warranty period is one year after delivery
- 7-2 Defective transducers attributable to manufacturer's responsibility shall be replaced for free, during the warranty period. However, following cases are out of the this replacement.
 - 7-2-1 Unsuitable handling or misuse by user.
 - 7-2-2 Modification or repair by user.
 - 7-2-3 Any other cases not responsible for manufacturer such as natural calamity, accident, etc.

This warranty covers only replacement. Any loss derived from failure or malfunction of the transducer, or cost to replace is excluded from this warranty.

Dimensions: unit mm

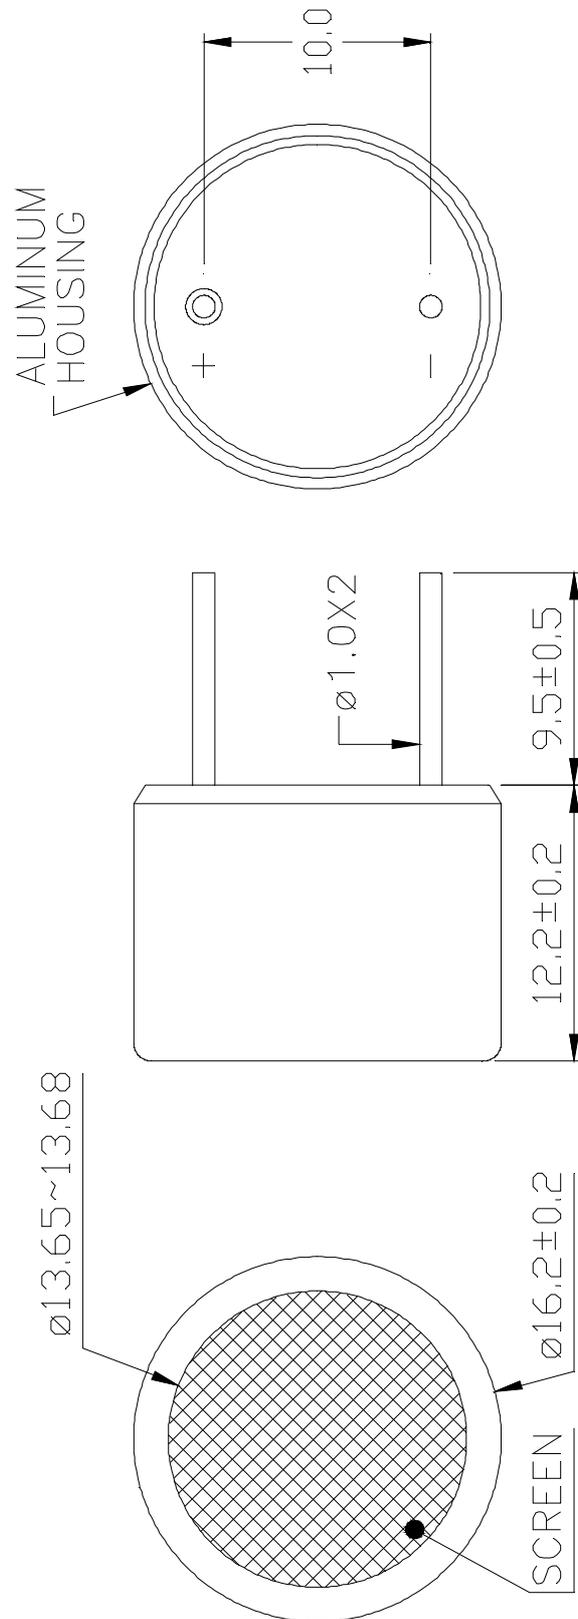


Figure 1

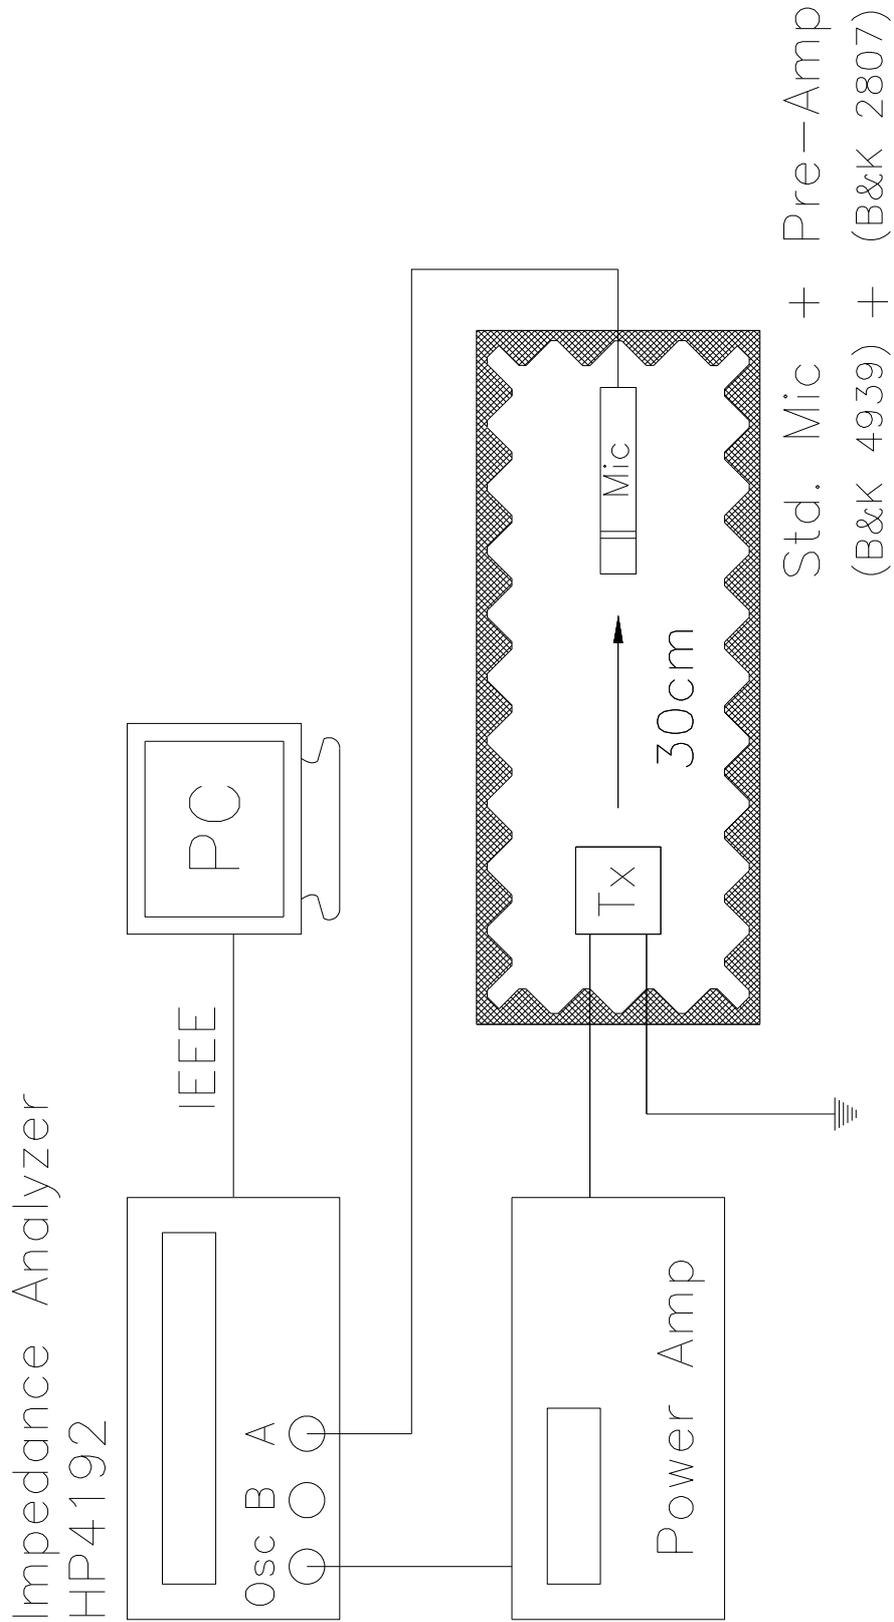


Figure 2

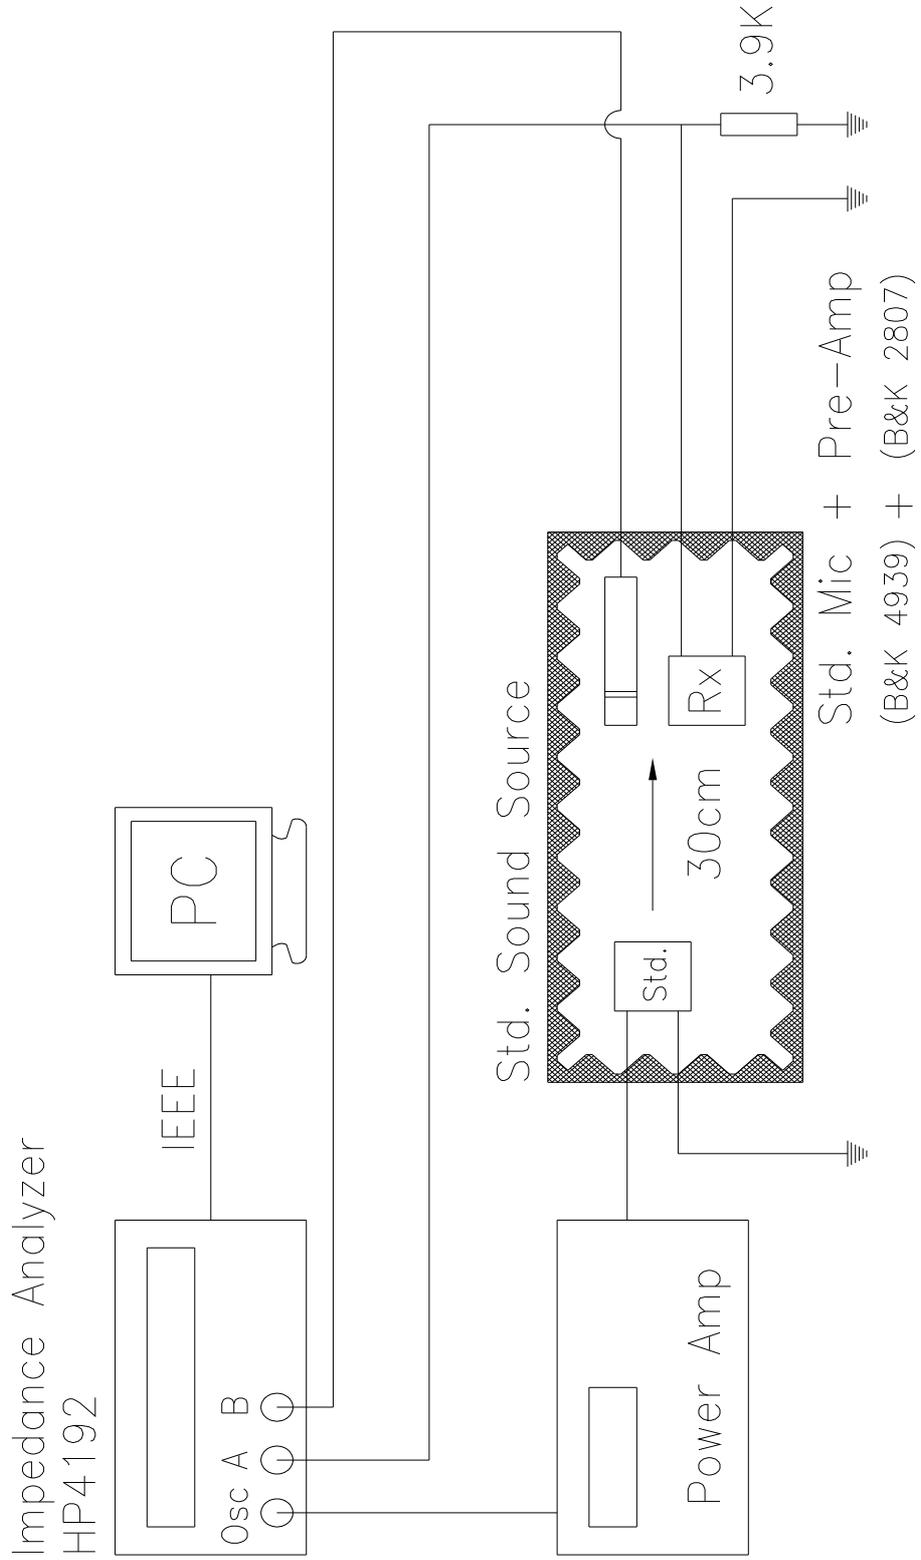


Figure 3